

R-104 DRAWING NUMBER  
 Center Pit  
 39-1


DRAWING NUMBER  
 39-1

DRAWING NUMBER  
 39-1

DRAWING NUMBER  
 39-1

AREA OF  
 WORK  
 THIS  
 PLAN

ALL OTHER WORK  
 SHOWN ON THIS  
 PLAN IS TO BE  
 PERFORMED UNDER  
 THE NUMBERS  
 92031(C) &  
 92035

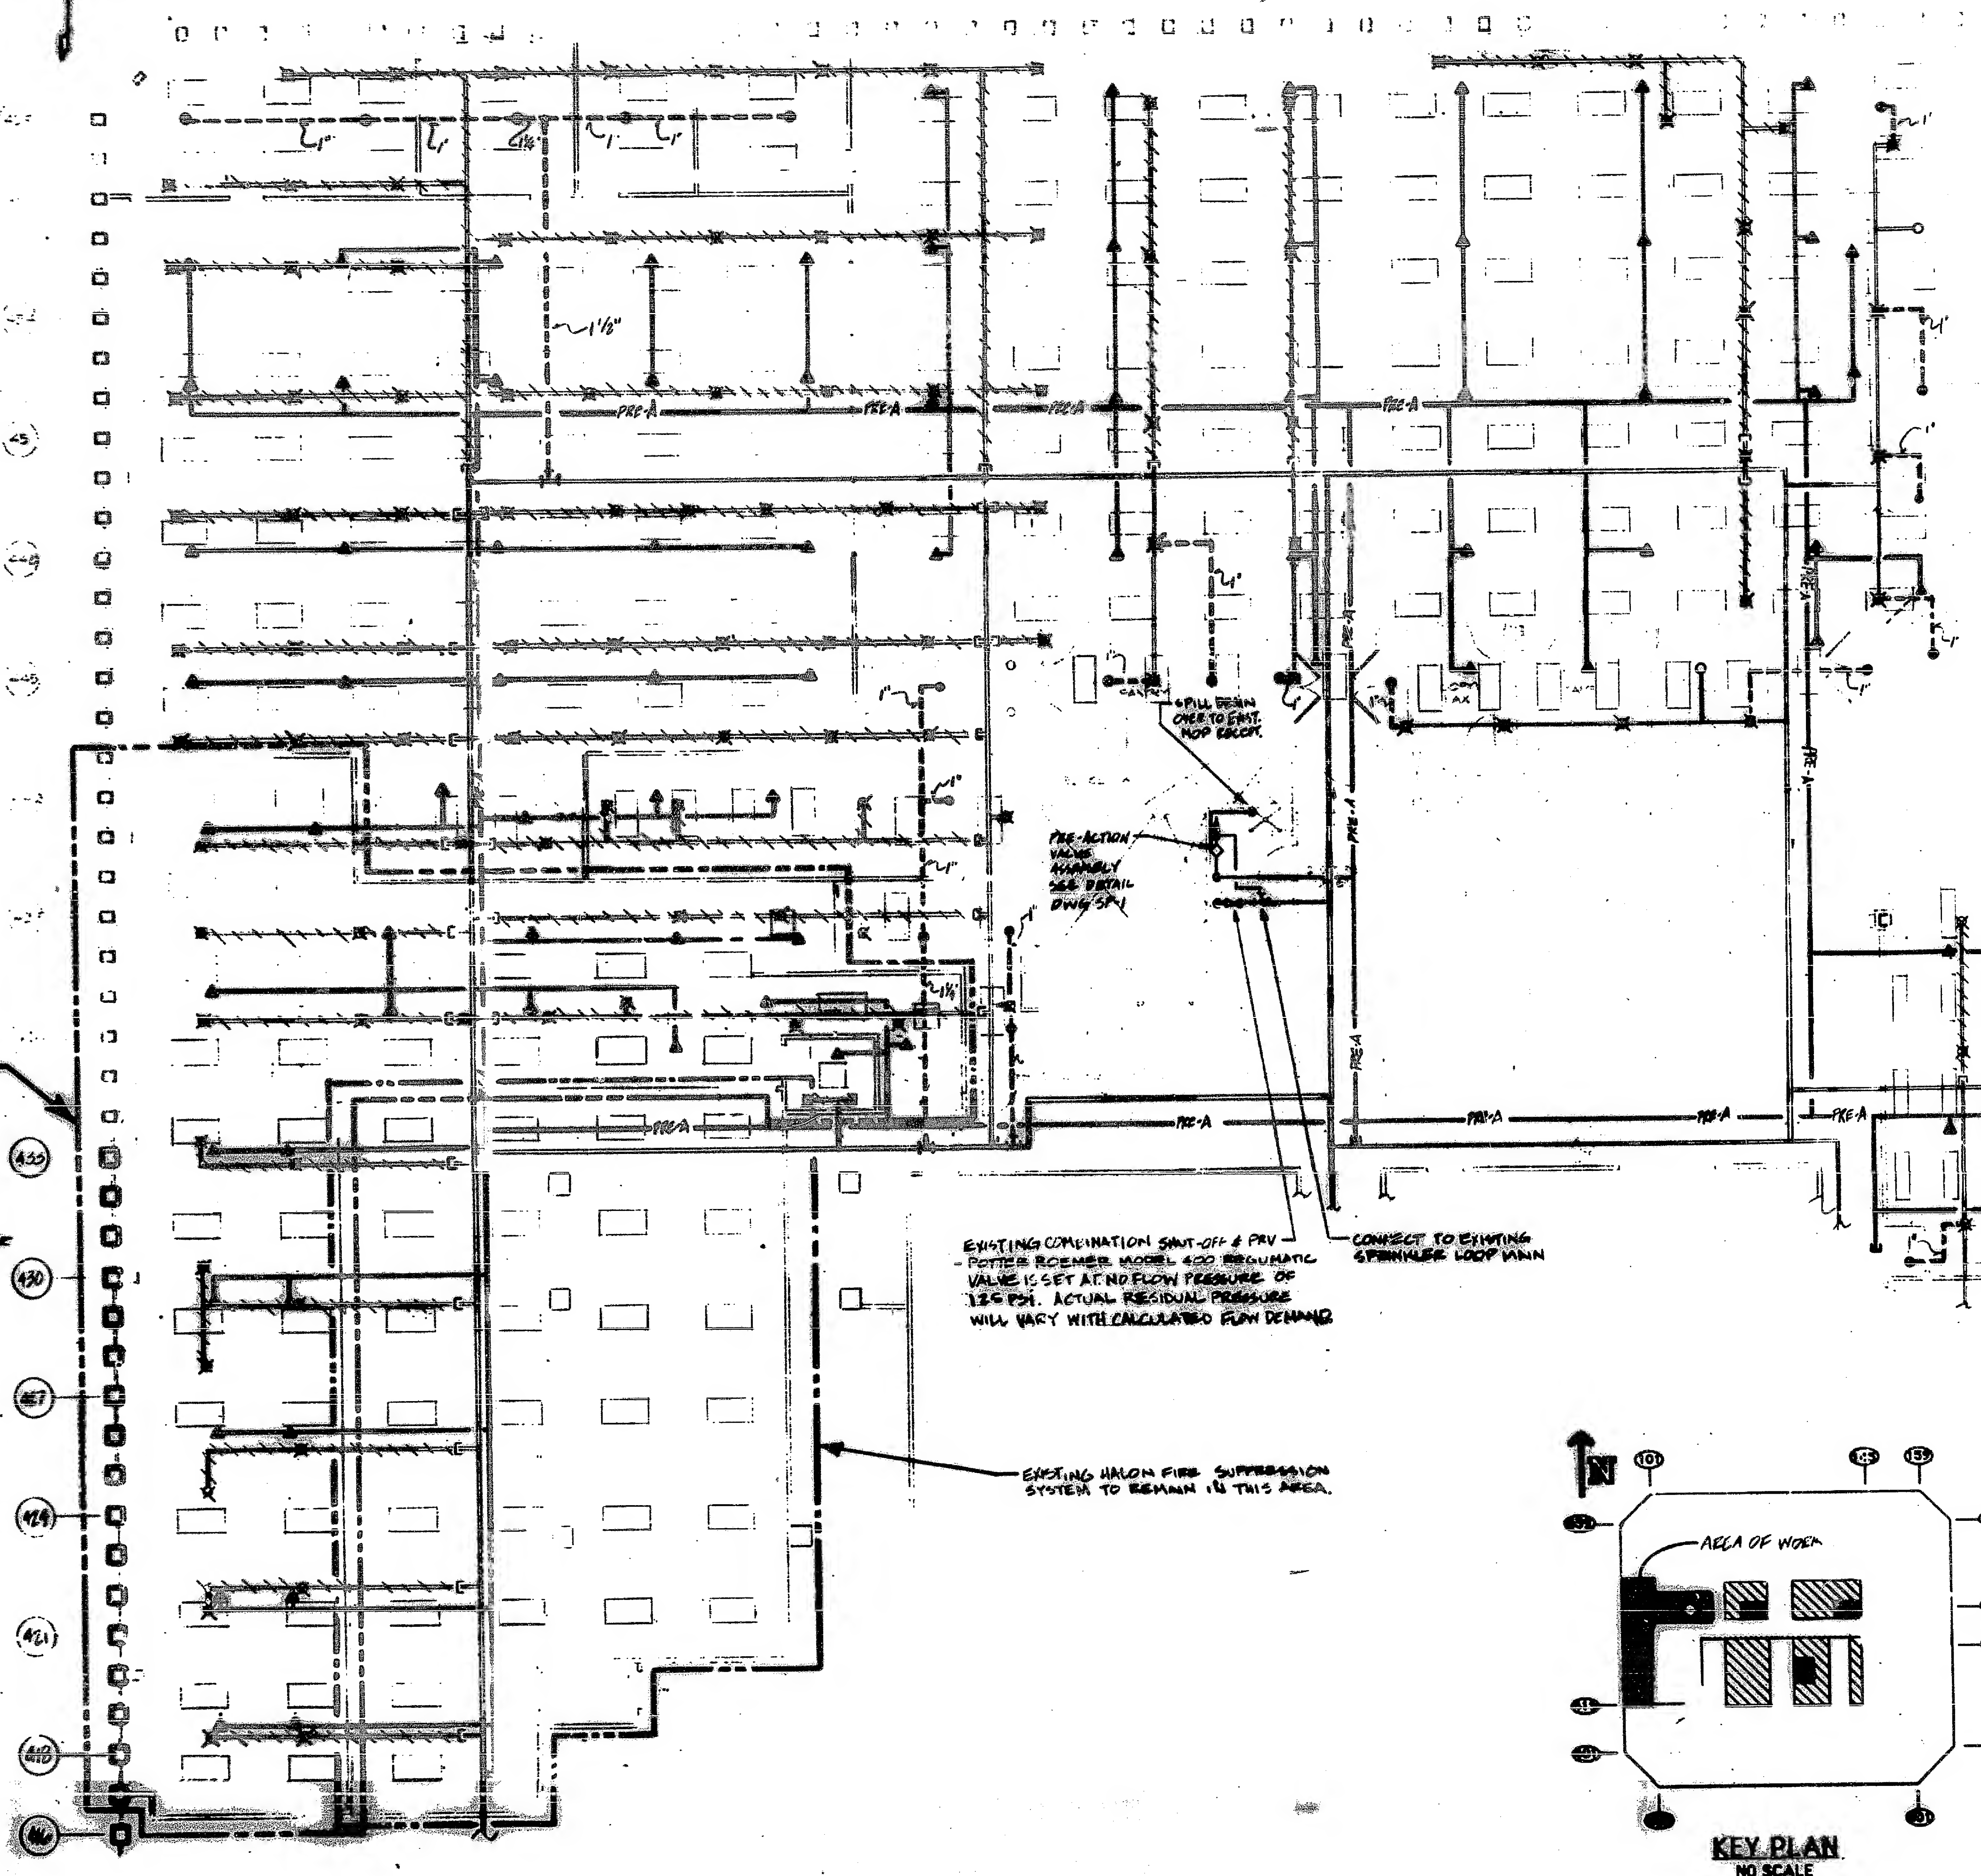

EXISTING COMBINATION SHUT-OFF & PRV  
 - POTTER ROEMER MODEL 400 REGULATING  
 VALVE IS SET AT NO FLOW PRESSURE OF  
 125 PSI. ACTUAL RESIDUAL PRESSURE  
 WILL VARY WITH CALCULATED FLOW DEMAND

EXISTING HALON FIRE SUPPRESSION  
 SYSTEM TO REMAIN IN THIS AREA

CONNECT TO EXISTING  
 SPRINKLER LOOP MAIN

